

Temporary Exhibit "A"



MANUFACTURER: \_\_\_\_\_  
 KVA: 50  
 VOLTAGE: 120/240V  
 LOCATION ID: \_\_\_\_\_  
 PHASE: C  
 FLUID TYPE: \_\_\_\_\_ DESIGN IZ: \_\_\_\_\_  
 SERIAL: \_\_\_\_\_  
 MATERIAL #: \_\_\_\_\_  
 ASSET ID #: \_\_\_\_\_  
 3 PHASE TRANSFORMER LOAD BREAK SWITCHES?  Y  N  
 WE ENERGIES EQUIPMENT ENERGIZED  Y  N  
 Customer EQUIPMENT ENERGIZED  Y  N EDC: \_\_\_\_\_  
 SWITCHED BY: \_\_\_\_\_ DATE/TIME: \_\_\_\_\_


MANUFACTURER: \_\_\_\_\_  
 KVA: 50  
 VOLTAGE: 120/240V  
 LOCATION ID: \_\_\_\_\_  
 PHASE: A  
 FLUID TYPE: \_\_\_\_\_ DESIGN IZ: \_\_\_\_\_  
 SERIAL: \_\_\_\_\_  
 MATERIAL #: \_\_\_\_\_  
 ASSET ID #: \_\_\_\_\_  
 3 PHASE TRANSFORMER LOAD BREAK SWITCHES?  Y  N  
 WE ENERGIES EQUIPMENT ENERGIZED  Y  N  
 Customer EQUIPMENT ENERGIZED  Y  N EDC: \_\_\_\_\_  
 SWITCHED BY: \_\_\_\_\_ DATE/TIME: \_\_\_\_\_

REMOVE 4 METERS  
 NZT662818, NZT662819,  
 NZT662820, NZT662821,  
 60A 120/240V IN BASEMENT

**WIRE KEY**  
**Z7 = 3 - 336 ACSR**  
**X9 = 4/0 CU**

**46' SLACK SPAN BETWEEN POINTS 10 - 12**

Circuit	Conductor and Tension	Sag Table In Inches		
		0'	30'	60'
Primary	1/0 ACSR @ 250 LBS	13	15	16
New/Sec	#2 ACSR @ 250 LBS	12	13	15

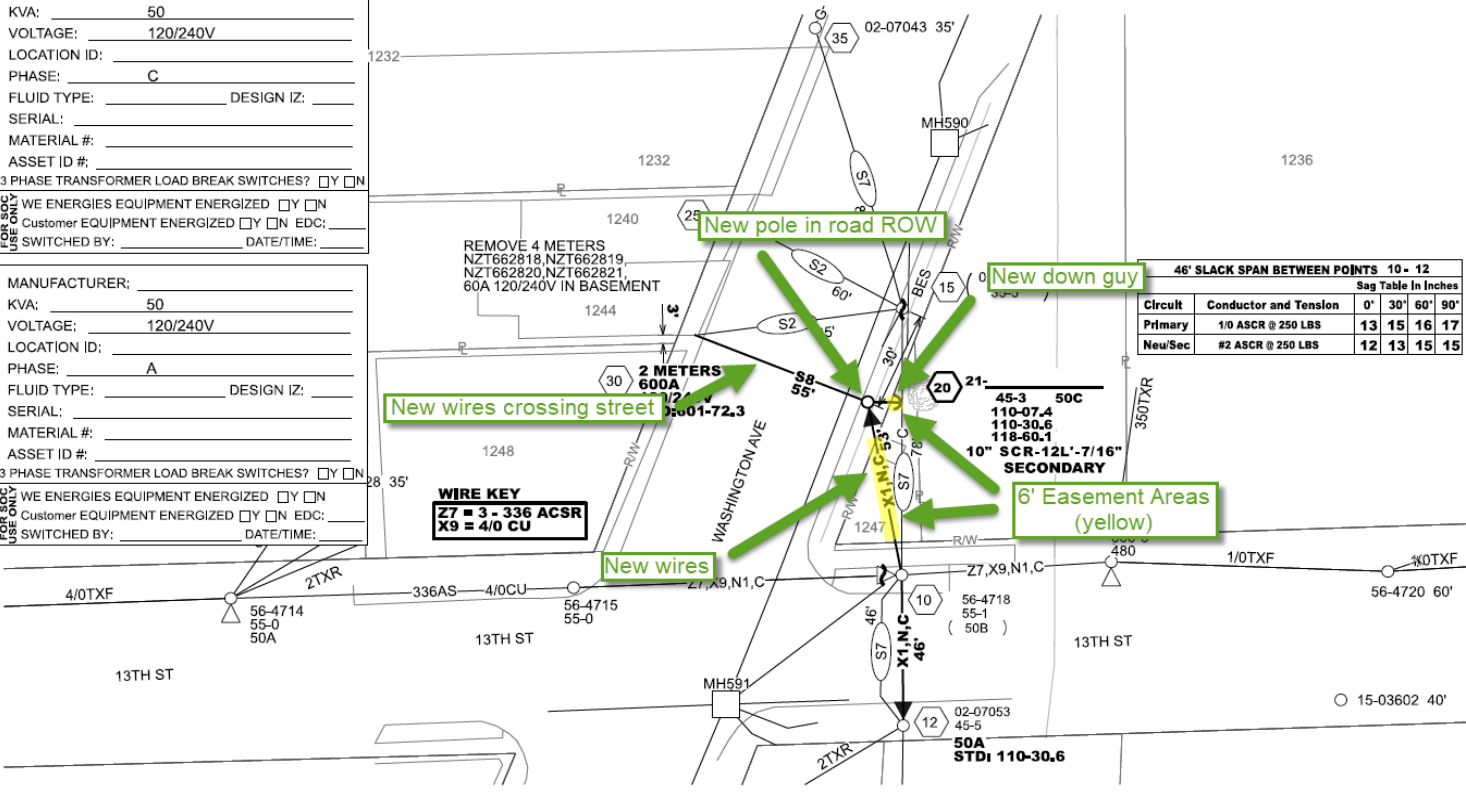

New pole in road ROW

New down guy

New wires crossing street

New wires

6' Easement Areas (yellow)