




ELECTRIC WORK REQUEST  
**4641183**



Temporary Exhibit "A"

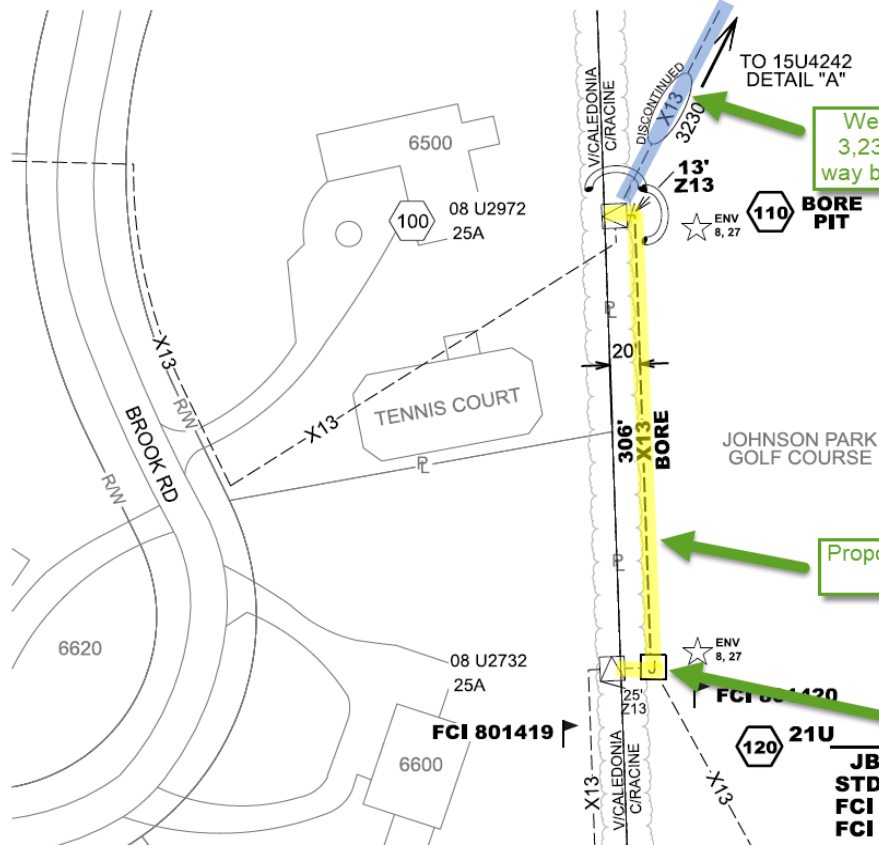

We could then abandon  
3,230 feet of cable all the  
way back to the transformer

FCI ATTRIBUTE

PLANNING

Feeder X15361  
Mount# 21U  
Direction NA  
Pole Ht A  
Phase A  
Type (OH/UG) UG

PROTECTION

Size 200  
Conduct. Units INDARD3

INSTALLATION


Manufacturer  
Date Manufactured  
Installation Date  
AD Serial #  
BD Serial #  
CD Serial #  
-- IF LOCATION IS ADJUSTED, CALL PLANNING ENG.  
STEVE HERBEL 920-433-1148  
-- CALL EDCO WHEN INSTALLATION COMPLETE

Proposed 12' Easement Area  
(yellow)

New junction box

**JB A**  
**STD 284-16.3**  
**FCI 801419**  
**FCI 801420**

DETAIL A

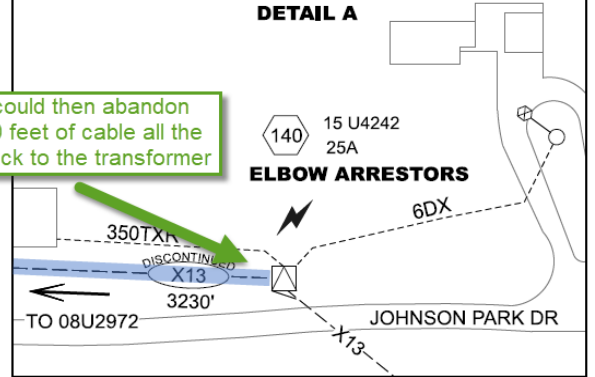

FCI ATTRIBUTE

PLANNING

Feeder X15361  
Mount# 21U  
Direction NA  
Pole Ht A  
Phase A  
Type (OH/UG) UG

PROTECTION

Size 200  
Conduct. Units INDARD3

INSTALLATION

Manufacturer  
Date Manufactured  
Installation Date  
AD Serial #  
BD Serial #  
CD Serial #  
-- IF LOCATION IS ADJUSTED, CALL PLANNING ENG.  
STEVE HERBEL 920-433-1148  
-- CALL EDCO WHEN INSTALLATION COMPLETE